

ZigBee Gateway User Manual V1.1

(Model: ZIGBEE-200)



Feature:

Operation voltage : DC 7V ~ 40V.

RS232 Interface

Meets or Exceeds TIA/EIA-232-F and ITU Recommendation V.28

Interface : $\pm 12V$ levels compatibility.

Data rate : 1200 bps up to 921600 bps

Characters : 5, 6, 7, 8

Parity : None, Even, Odd

Stop bits : 1, 1.5, 2

Control signals : TxD, RxD, GND

RS422/RS485 Interface

Meet the requirement of the EIA/TIA-485

4-wire signals : TX+, TX-, RX+, RX-, GND

Support terminal resistor for TX and RX.

Up to connect 256 devices on the bus.

Maximum bit rate up to 115K bps.

Bus protection:

$\pm 30KV$, IEC 61000-4-2, Contact/Air Discharge.

$\pm 30KV$, IEC 61000-4-4, EFT(5/50ns).

$\pm 30KV$, IEC 61000-4-5, Surge(8/20us).

Ethernet Interface

Built-in 1.5KV magnetic isolation.

Ethernet Interface : 10Base-T, 100Base-TX

Ethernet Speed/Duplex : Auto-negotiation 10/100Mbps, Full/Half duplex

Protocols Supported : ARP, IP, ICMP, UDP, TCP, DHCP, TFTP, HTTP.

Network Services : TCP Server, TCP Client, Web Control.

Auto-MDIX : Yes

Build-in web server setting page for parameter by user.

Support all operation system, don't need any driver.

Cross domain parameter setting utility for windows XP/VISTA/windows 7.


Support Virtual Serial Port (VSP) utility for simulate RS232 COM port.

Internet of things: Integrated with Zigbee or Bluetooth products.



Product profiles:

1. DB9 male : RS232 connector.

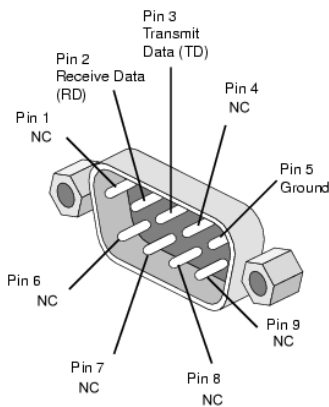


2. RJ45 : TCP/IP Ethernet connector.
3. RS422/RS485 terminal resistor: Short is enabled, open is disabled (2.54mm).

Please use two jumps for to enable the terminator function.




- RS232/RS485 mode switch.

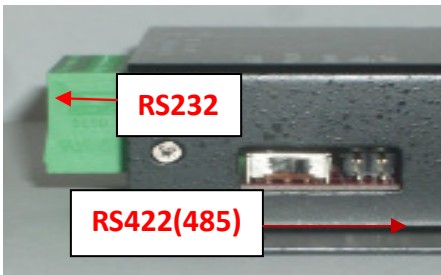

- RS422/RS485 4-wires connector.
VCC-GND : DC 7~40V input.



- DC power connector : DC 7~40V input (Φ2.0mm).



- LED indicator : Red-Power, Orange-Ready, Green-Link.
- Reset key : Reset module.

Default setting:

The module default IP address is 192.168.0.1, this module build-in a homepage for setting, so user can change internal parameter setting by browser.

Quick start:


- Connect RJ45 to Ethernet.
- Select RS232 or RS422/RS485 mode.
- Connect RS232 DB9 or RS422/RS485 4-wires bus.
- Connect DC power input.
- Check LED indicator.

User can use browser and entry the URL(<http://192.168.0.1/setting.htm>) for setting.



About the web server setting page as below:

2011.01.20

TCPIP to RS232	
 <i>nReader</i> <i>takecare your life!</i>	TCPIP to RS232 Module
Serial Settings	
Data Baud Rate	57600 ▾
Data Bits	8 ▾
Data Parity	None ▾
Stop Bits	1 ▾
Flow Control	Hardware ▾
Network Settings	
	<input type="checkbox"/> Enable DHCP
Static IP Address	192.168.0.1
Static Subnet Mask	255.255.255.0
Static Default Gateway	192.168.0.1
Static DNS Server	168.95.1.1
Connection Type	TCP ▾
Transmit Timer	1
Server/Client	Server ▾
Server:	
Server Listening Port	4000
Client:	
Destination IP	192.168.0.2
Destination Port	5000
	<input checked="" type="checkbox"/> Enable Reboot
	Apply Reset
	Firmware Upgrade

User can change any parameter, once the parameter was finished, user can press the 'Apply' button, and new parameter can be saved to module simultaneously the module will reboot.

The main page mainly provides two functions,

- (1) **Apply**: to update the configuration value on the device server(s).
- (2) **Reset**: to reset the configuration value to the factory default settings.

Notice: The 'Firmware Update' button doesn't press.

Environment setting:

The module factory default IP address 192.168.0.1, so, when in use, please note that if there are other devices that are located on the same IP address.

Setp 1: First check IP address, in window XP item "Start" → "Run".


2011.01.20



Entry "ping 192.168.0.1" command, and press "OK".



When the console window display as below:

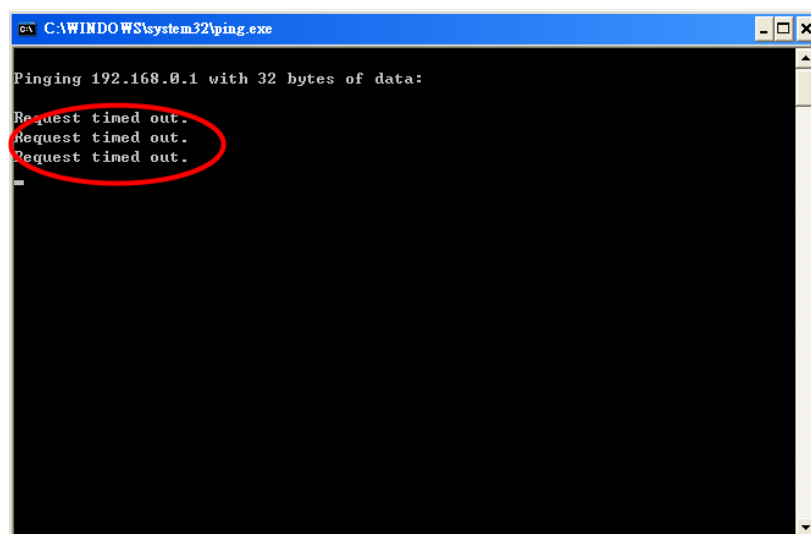



When you see the "Request timed out" message, said there is no device IP: 192.168.0.1 address, this screen will then automatically shut down.

Step 2: Verify that the domain is the same as the IP address is 192.168.0.1, so the domain is in the 192.168.0.x where, if the first three digits of your computer not the same with this domain, you can

not link to this mode group. You can select "Start" →"Run" →"My computer"

Neighborhood" →" View Network Connections".

2011.01.20

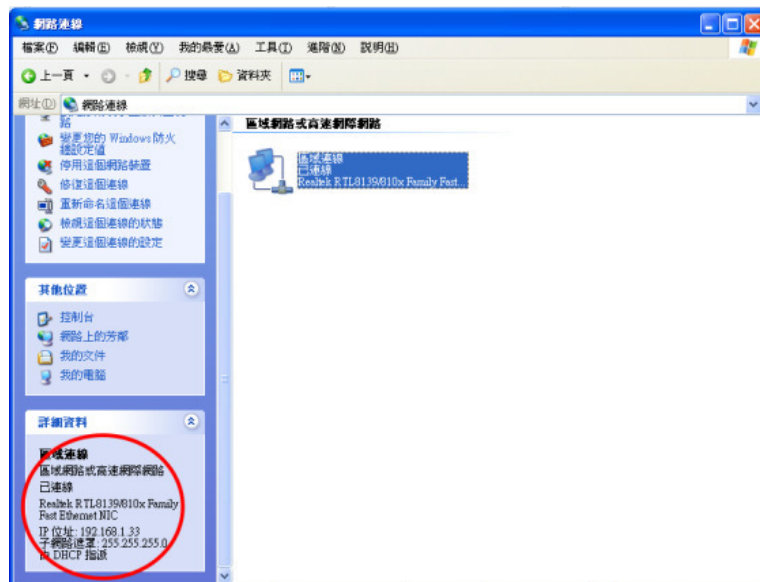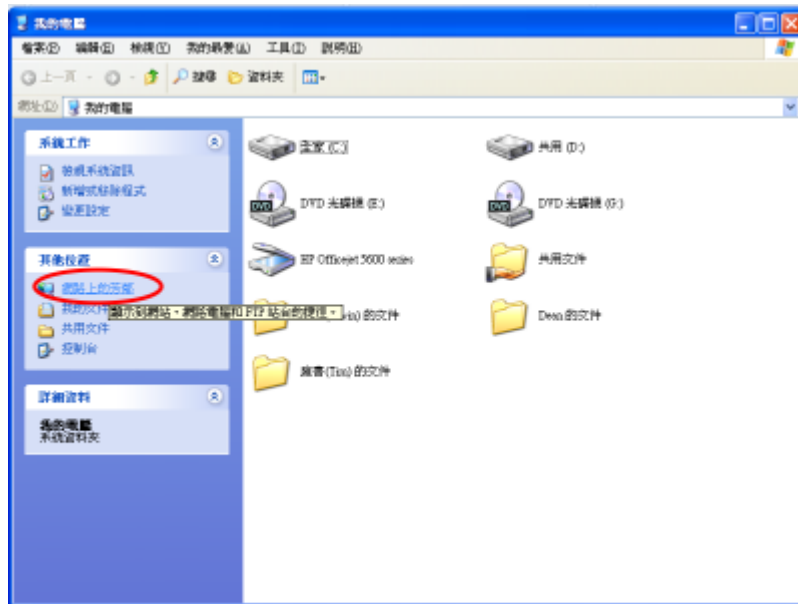

If that is not the same domain, use a fixed IP address of the IP way to 192.168.0.x, Gateway IP: 192.168.0.254.


Step 3: Recognition and computer wiring is correct, if your computer has through the Hub is connected to this module, then you can use the network cable to the general, if the computer is directly connected with the module, then you must use a dedicated network handshake line before the connection is successful.

2011.01.20

Step 4: If the domain is configured correctly success or wiring, you can use the "ping 192.168.0.1" in the way of a successful connection recognized.

Then you can use the browser to open the setup screen.

2011.01.20

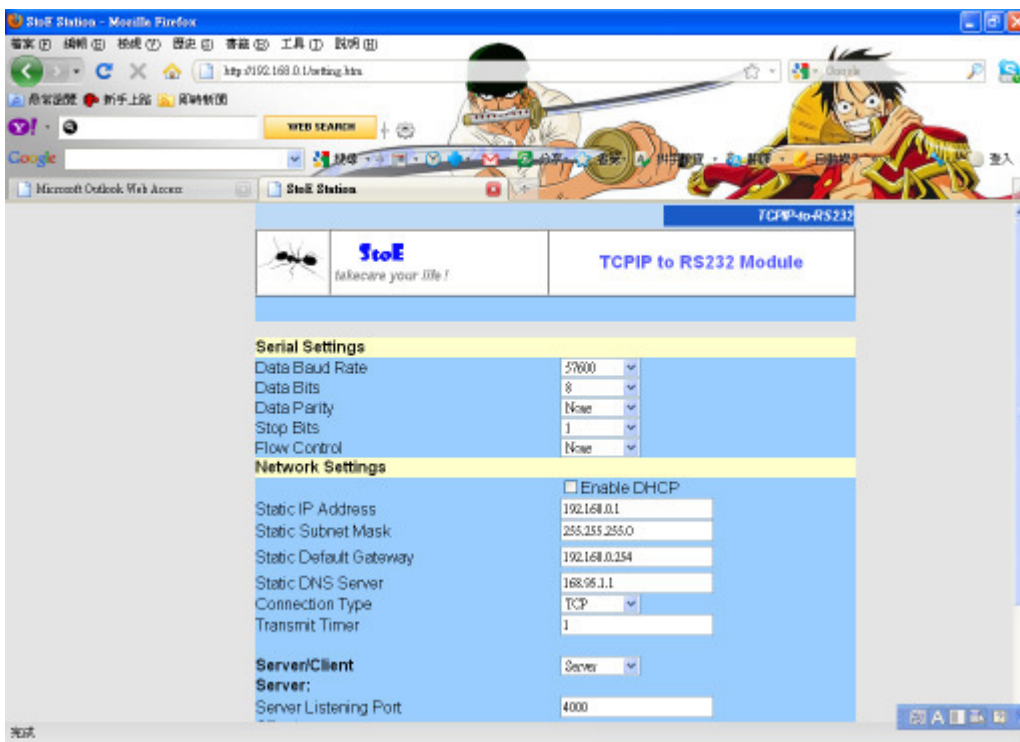

Parameter Setting:

This module is divided into two parts parameter:

Serial Port setting


Network setting

When you set is complete, simply press the "Apply" button, if the "Enable Reboot" are ticked, then this module will reboot, reboot time because flowers to 5 to 10 seconds, so you may see the screen can not display the error

message.

2011.01.20

At this point you re-enter as long as the web site again and press "Enter" key, the screen will re-appear.

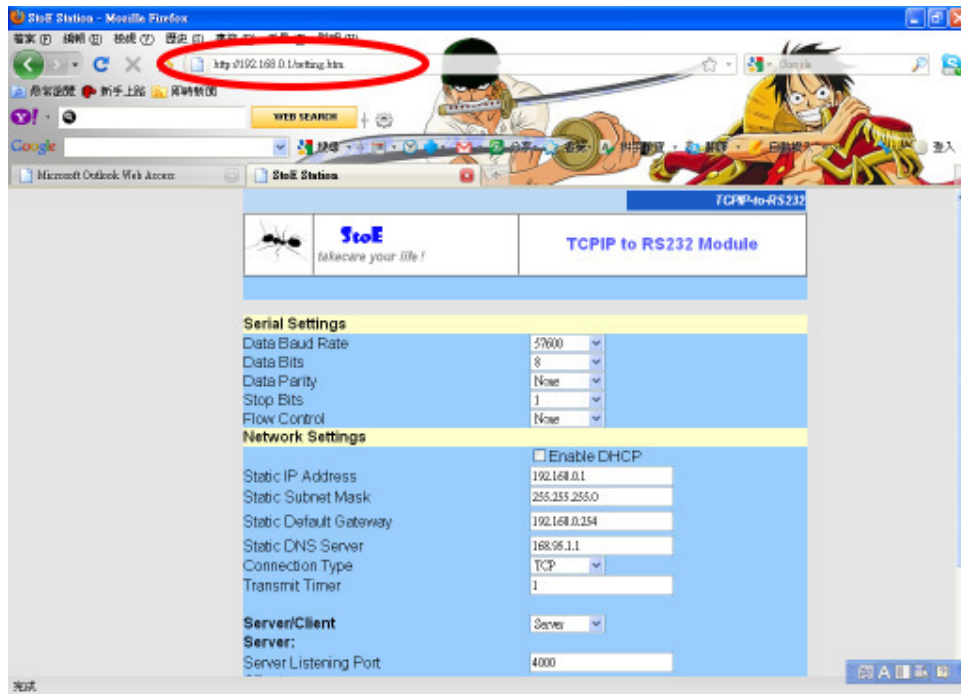

Serial Port setting:

Data Baud Rate : RS232 bit rate, the range from 1200、2400、4800、9600、19200、38400、57600、115200、921600。

Data Bit : The number of data bits transmitted, the range from 5、6、7 and 8 bits。

Data Parity : Transmission of the parity bit check method , the type are Odd、 Even and None。

Stop Bit : Number of stop bits , the type are 1、 1.5 and 2 bits.

Flow Control: Flow control method, the type are Xon/Xoff、 Hardware and None.

Network setting:

Enable DHCP : Enable DHCP function.

IP Address : Static IP address , use IPv4 define。

Subnet Mask : Mask address , normal setting is "255.255.255.0"。

Gateway : Gateway address , normal setting is "xxx.xxx.xxx.254"。

DNS server : DNS address, Can point to any one DNS server, we are the factory default value is

2011.01.20

pointing to Taiwan Telecom's DNS server.

Connection Type : TCP and UDP is divided into two types, their advantages and disadvantages are as follows:

Protocol	Advantages	disadvantages
TCP	Reliable transmission, the program can be omitted and reliable mechanism	Transmission speed slower.
UDP	Large transmission capacity, rapid	Unreliable, the program may need to provide a reliable mechanism for self.

Transmit Timer : Data packets sent between the serial interval.

Server/Client : This machine type, the default value is Server.

Listening Port : Multiple applications in the corresponding port will address, in which the range of 0 to 1023 is known to the general code used by the so-called (Well-Known Ports), for example: Port 21 is used for FTP, Port 80 is for Http used, as the dynamic port (Dynamic Ports) to users to decide on opening up, ranging from 1024 to 65535.

Destination IP : When this module is set to Client, enter the IP address of the remote host server.

Destination Port : When this module is set to Client, enter the remote host server port address.

Enabled Reboot : Start Module reboot.

Apply : Confirm the setup is complete.

Reset : Reserved.

Firmware Upgrade : Reserved.

Test Method Description:

In Windows, the software has built-in Hyper Terminal, but less in the maintenance of the software, so there are many problems, users are recommended to use Tera Term software to replace the Super Terminal, this is free software, download the following address:

<http://toget.pchome.com.tw/category/utility/26504.html>

Or use the downloadable Google search URL.

First of all be determined in accordance with the environment set the domain PC and module are

the same, then the test board and module ready and connected with the PC's COM port and also connected to the Ethernet network.

10

Internet
2011.01.20

When the connections are completed, then the first open Tera Term from the first screen, select the Serial port

address.

COM port after setting the parameters, in the Setup-> Serial port open parameter setting screen, the set of the RS232 module parameters must be the same, otherwise it will not connect.

Tera Term then open a second screen, File-> New connection, select the TCPIP host

11

2011.01.20

address.

When TCPIP is also set to complete, Tera Term window, there were two RS232 and


TCPIP.

Transfer Mode RS232-> TCPIP


At this point you have to do RS232 screen, press a different key, in the meantime will appear on the screen under TCPIP.

12

2011.01.20

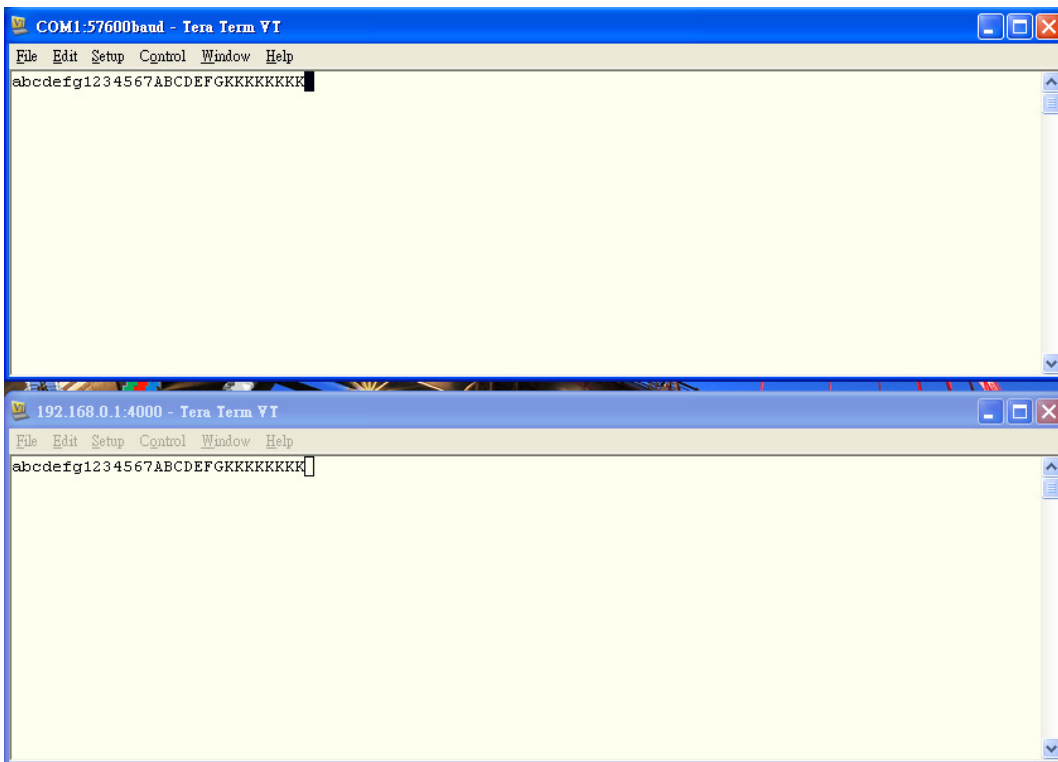

If at this time the wiring RS232 and PC separately, you are still in the RS232 screen, press a different key, this time will not you just press the TCPIP any character.

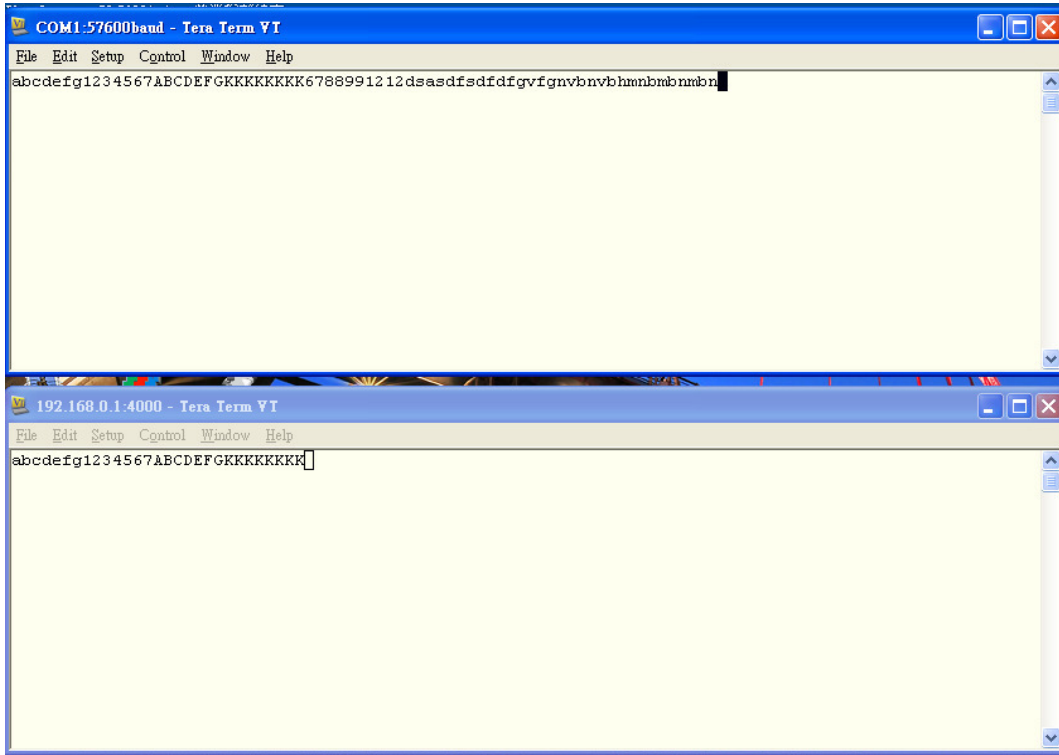

Transfer Mode TCPIP-> RS232

To transfer data through the TCPIP to RS232 picture of the screen, please enter the text in the TCPIP screen, be sure to press the Enter key, then just enter the text can send out.

First look at the screen display settings, select Setup->


2011.01.20

Terminal.

When the Terminal setup screen appears, in the New-line-> Receive select "CR +

LF”

Two Terminal are set to do the same, after TCPIP enter a text screen, press the Enter

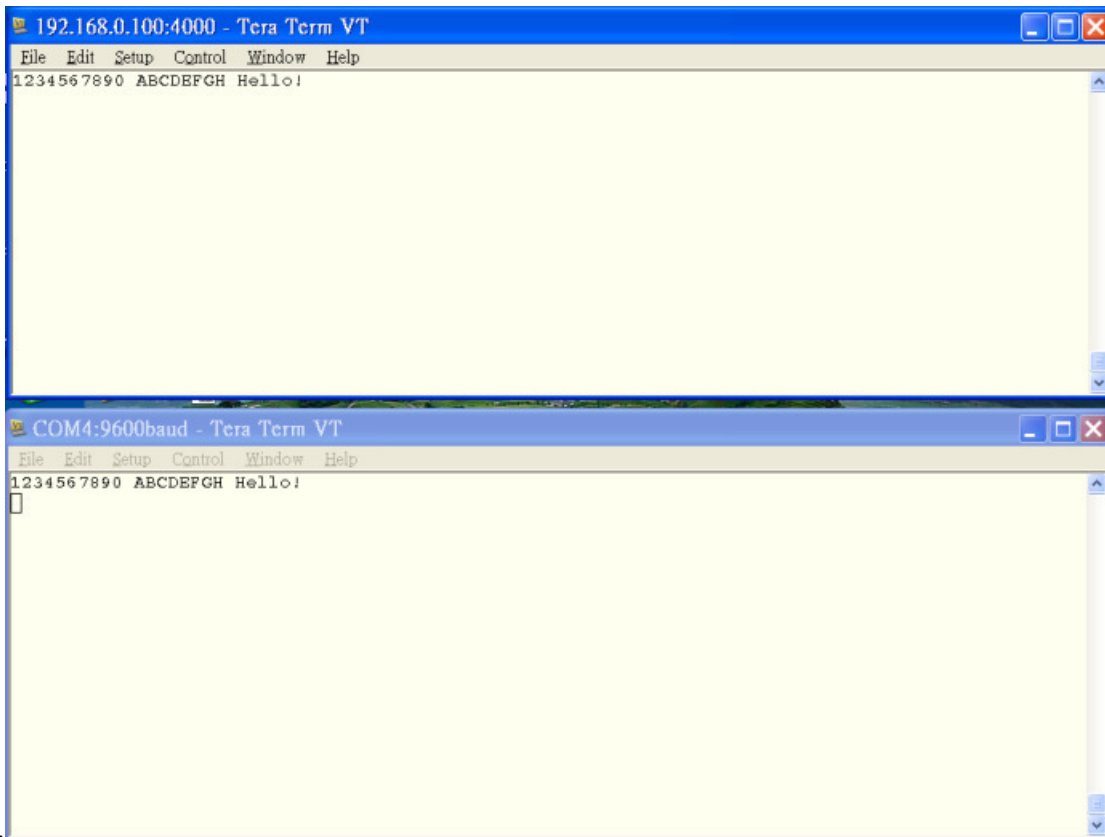

Key.

Server mode instructions:

Use this mode is set for each Device Server-side, this time the initiative to send or read data from a remote Client host launched through polling (Polling) way, one by one on each Device send command, in principle, each Device must be set to a fixed IP mode, so the remote Client only way to query one by one.

2011.01.20

Server

Server

Server

Server

Client mode instruction:

Use this mode is set for each device client-side, this time the initiative to send or read data from the client-side initiated automatically every time client requested connection, once the connection is successful, client will automatically send IP and MAC address, so that the remote server know which one client has the connection is successful, the device can be configured for each variable or fixed IP mode. Once the connection is complete, client can take the initiative to send or read data to

2011.01.20

Client

Client

Client

Client

Server

Client


Client

Client

the server.

Client

Set as follows:

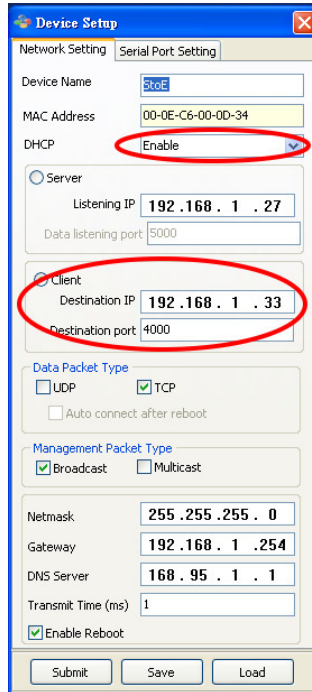


Using a fixed IP or floating IP can select client mode and IP port pointing to a remote location and server location.


2011.01.20

Client mode Demo software:

First, open the Server-side software to start listening for connections coming from the Client-side requirements, when you press the “Receive” button, the software started listening.

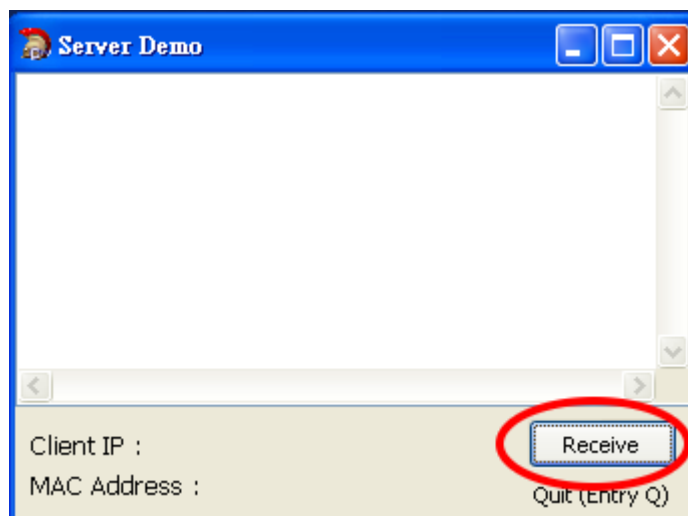


When the software receives client connection requests and respond to the end of the connection, it will show a successful connection message, and will show the client-side IP address and MAC address.

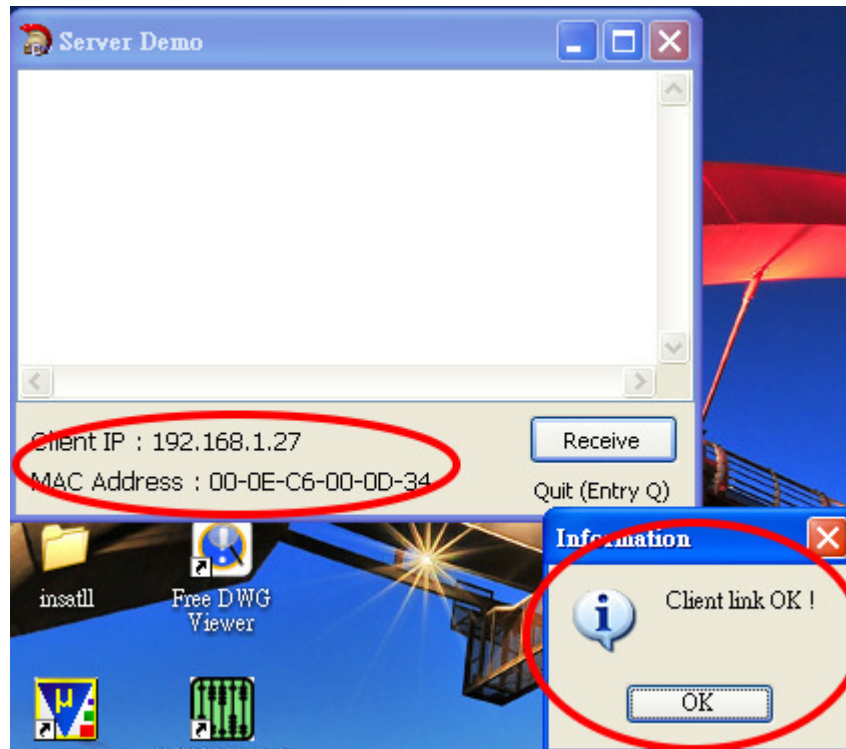

Open Tera Term screen for COM port ◦

18

2011.01.20

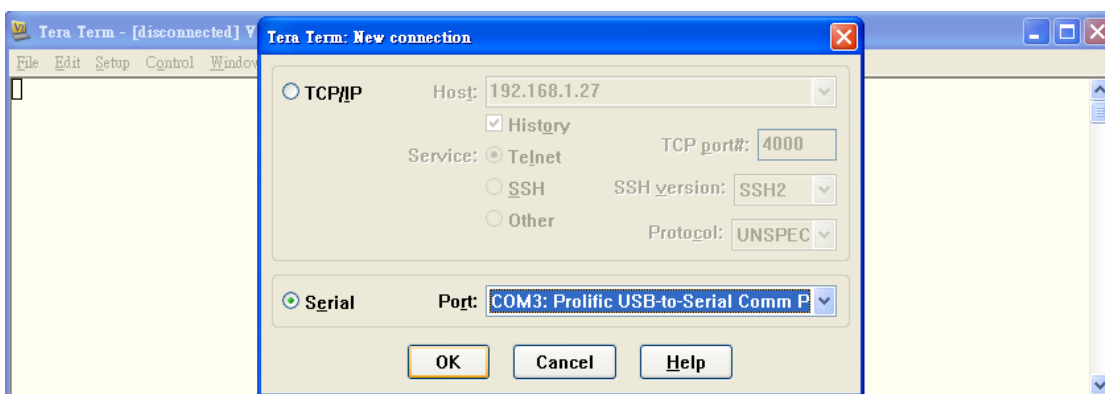

At this point in the COM port screen, enter any character, all will be immediately displayed in the software screen on the Server-side.

If server want to cancel the connection with the Client-side, please enter the capital of the 'Q' can be.

